
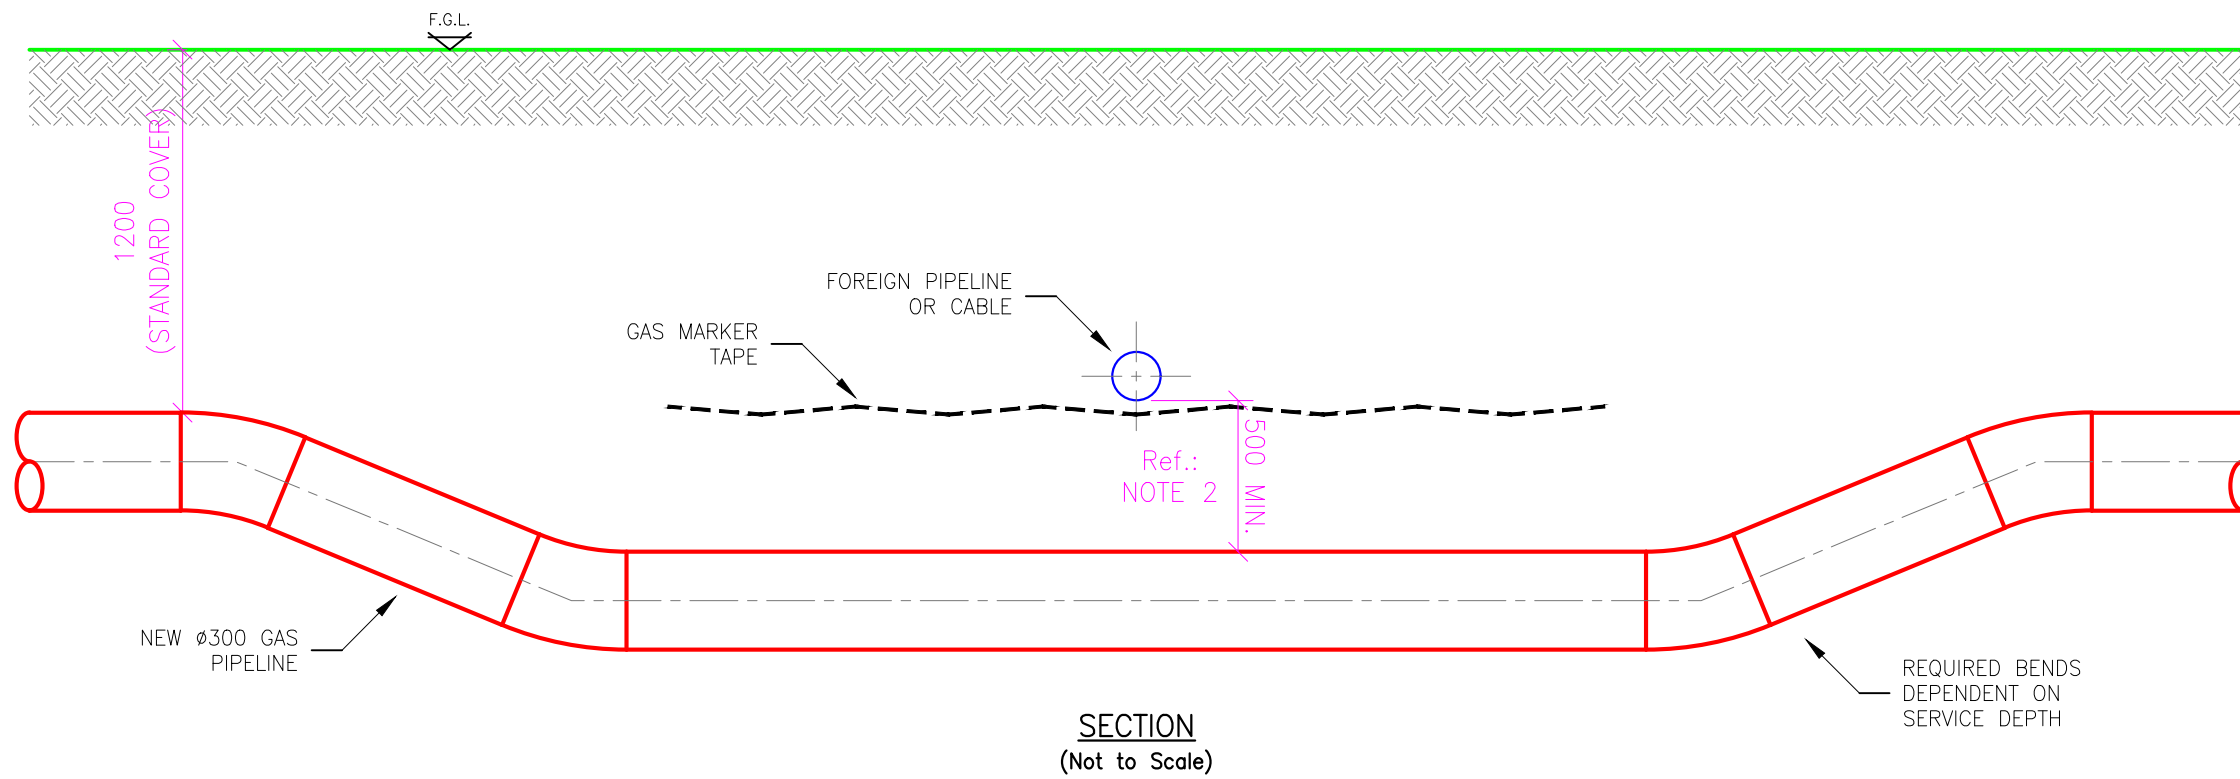


**NOTES:**

1. ALL DIMENSIONS ARE IN MILLIMETERS UNLESS OTHERWISE STATED.
2. A MINIMUM CLEARANCE OF 500mm TO BE MAINTAINED TO IRISH WATER MAINS, ELECTRIC CABLES, STORMWATER MAINS, SEWER GRAVITY MAINS, GAS DISTRIBUTION MAINS AND ALL OTHER SERVICES AS PER IS 328:2021 AND GNI/AD/SP/007.
3. MARKER TAPE TO BE DETECTABLE 300mm WIDE TAPE LABELLED "CAUTION BURIED GAS PIPE".

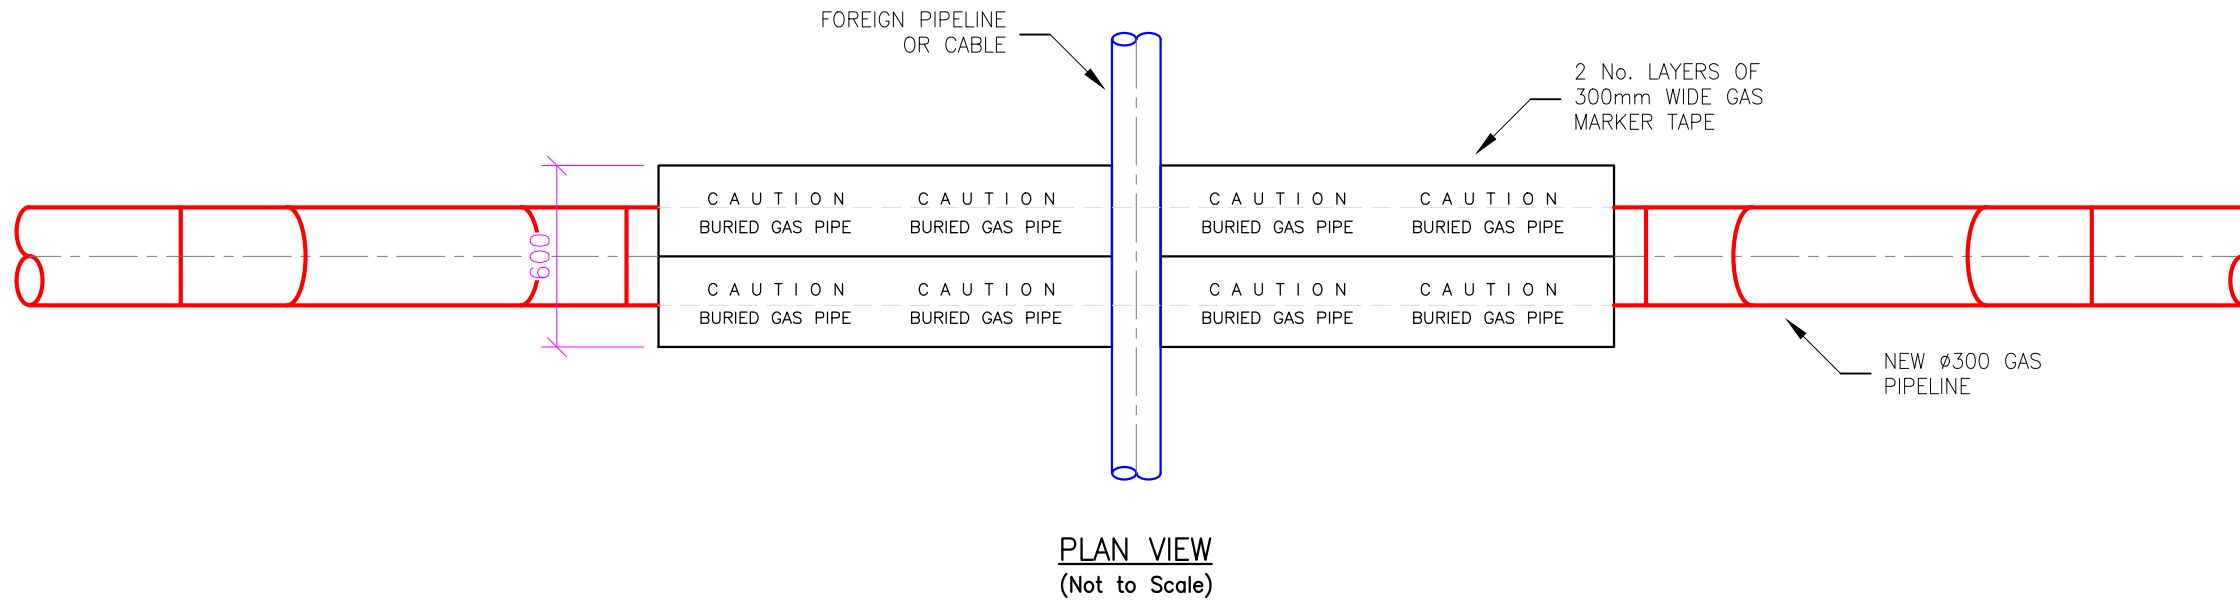

**PLANNING ISSUE**

0	PLANNING ISSUE	RMD	TM	JC									<b>APPROVALS</b>		PROJECT	
		22/04/2026	22/04/2026	22/04/2026											47327508 - Gas to Bord na Mona, Edenderry	
													A	DRAWING OFFICE	DRAWN BY R.McDONNELL	
													B	DESIGN ENGINEERING	CHECKED T.MALONE	
													C	STRATEGY/PLANNING	APPROVAL J.CONROY	
ISSUE	REVISION	REV. BY	A	B	C	D	E	F	G				D	DESIGN MANAGEMENT	DATE 22/04/2026	
CONSULTANT		Gas Networks Ireland		P.O Box 51, Gasworks Road, Cork, Rep of Ireland T +353 21 4534000		DRAWING NUMBER GNI143-GNI-PL-MIS-0003		SCALE NTS @A3		SHEET 01 OF 01						
<p>Bridge Street Centre Portlaoise Co. Laois Ireland T:(00353)(0)57 866 5400 www.fingleton.ie</p>																